



DrägerRay

Dräger


Semi-Closed Nitrox Rebreather





DrägerRay


Dräger

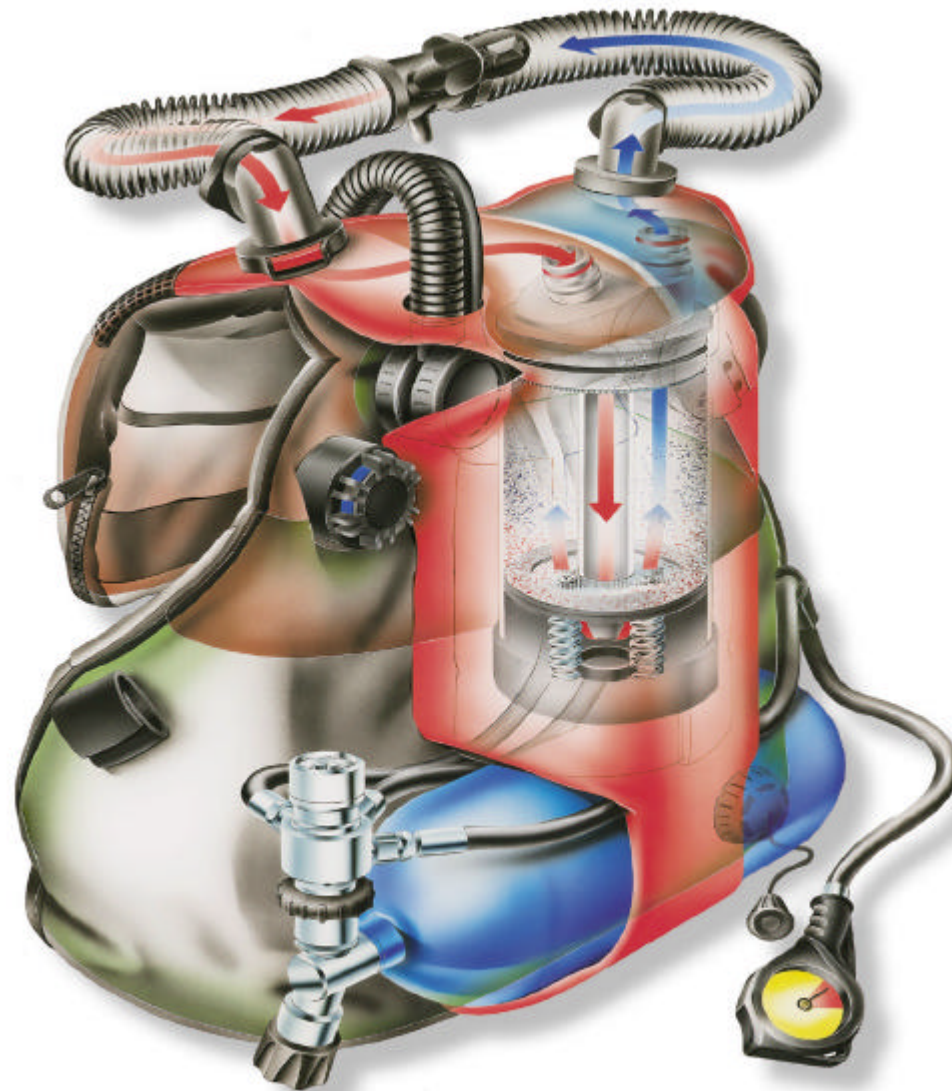



DrägerRay


Dräger

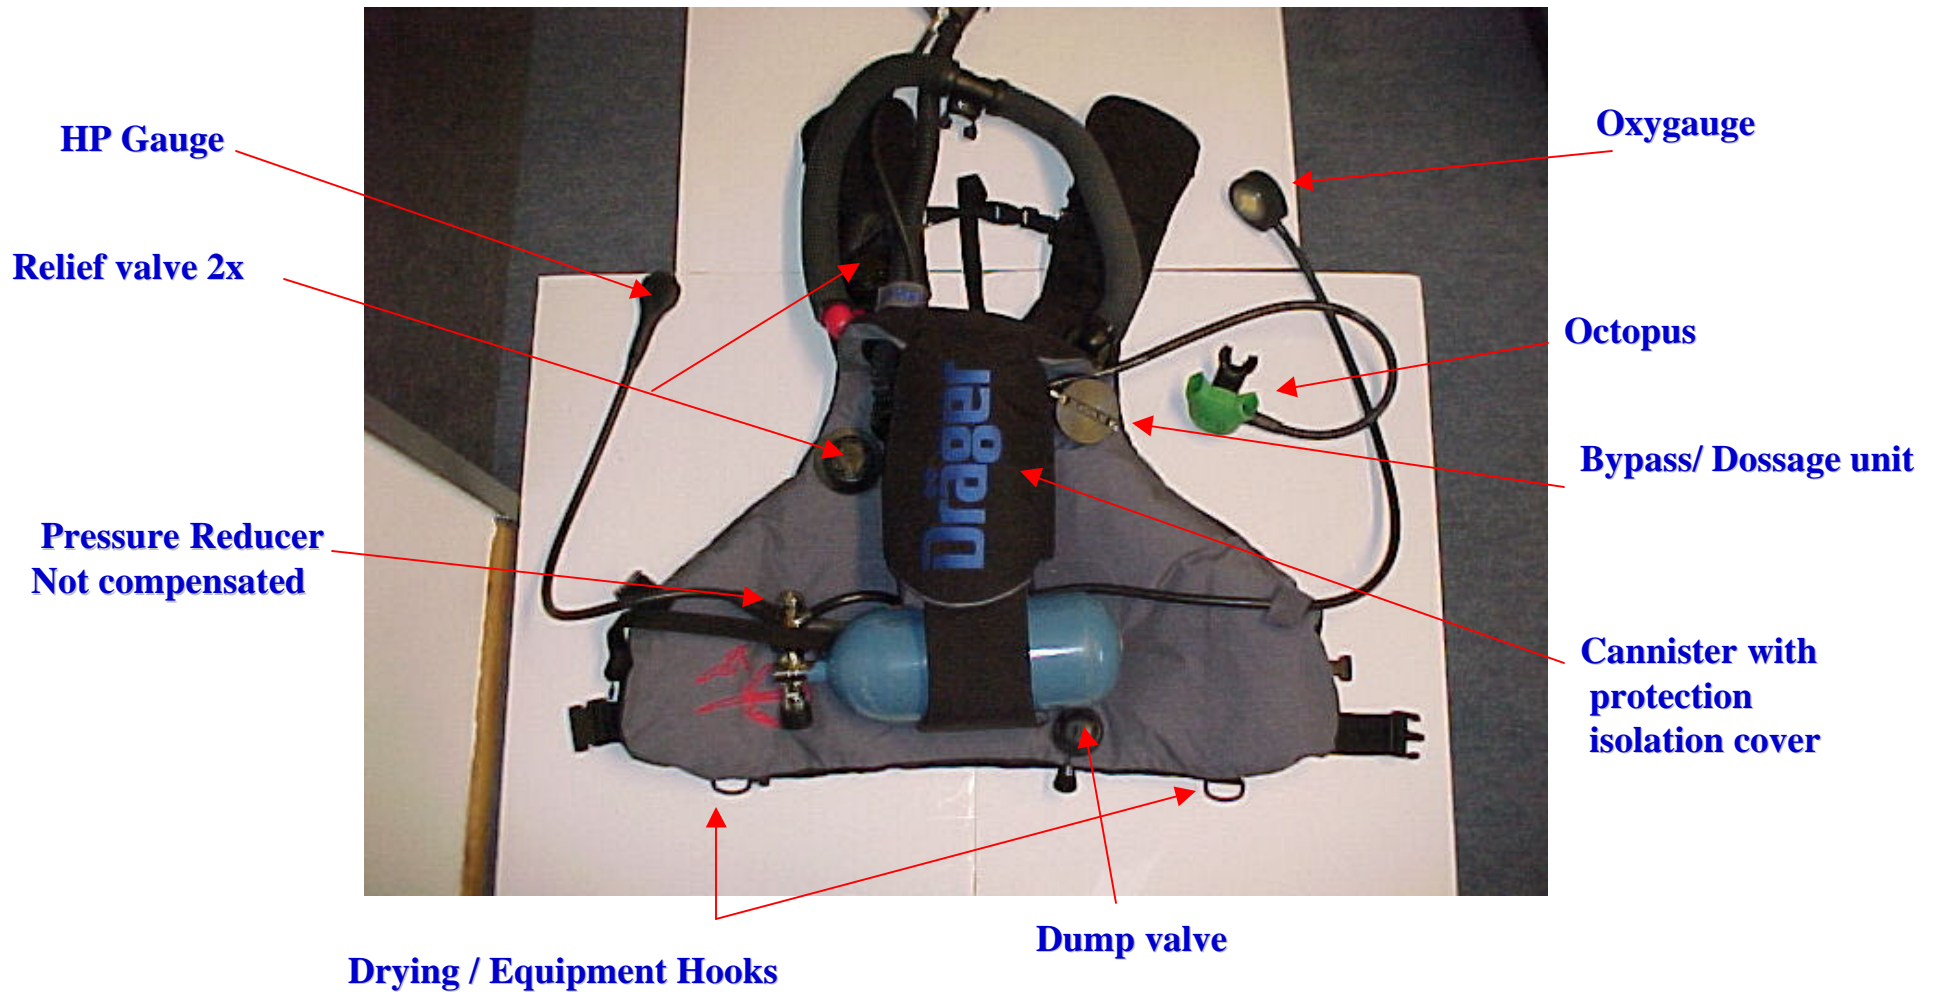



DrägerRay

Dräger

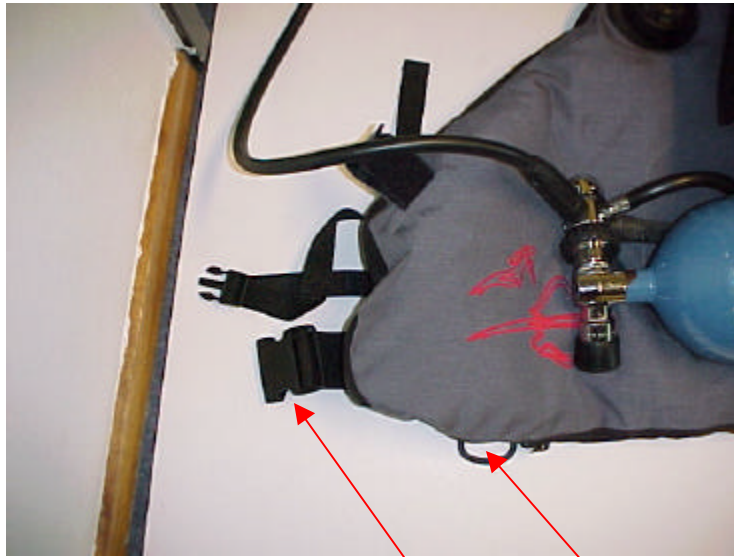

Dump valve

Drying hooks / Equipment hooks

Belly belt big and small



DrägerRay

Dräger



Dosage unit with Bypass valve
Red marking is 50% Nitrox
Yellow marking is 32% nitrox.
By changing the complete housing
we change between the to gasses.




Relief valve on left shoulder for adjusting
breathing resistance when standing in the water.
Adjustable between 18 and 25 Mbar.

Push in connection
with red marking for Exhalation side



DrägerRay

Dräger

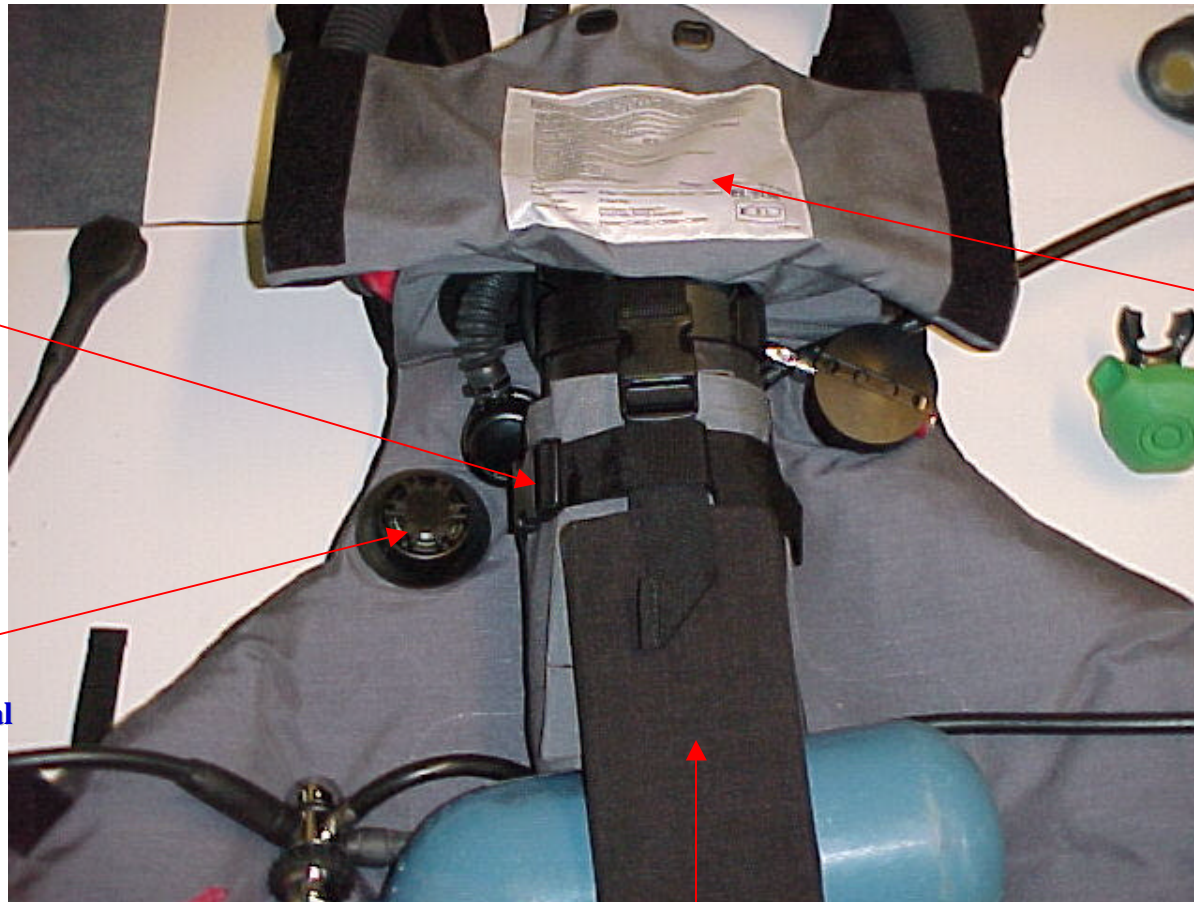

Strap for keeping
Canister cover with
integrated weight
pockets together

Cover Canister
with Short instruction


Relief valve for horizontal
position in the water

Connecting Belt to keep cylinder and canister together



DrägerRay

Dräger

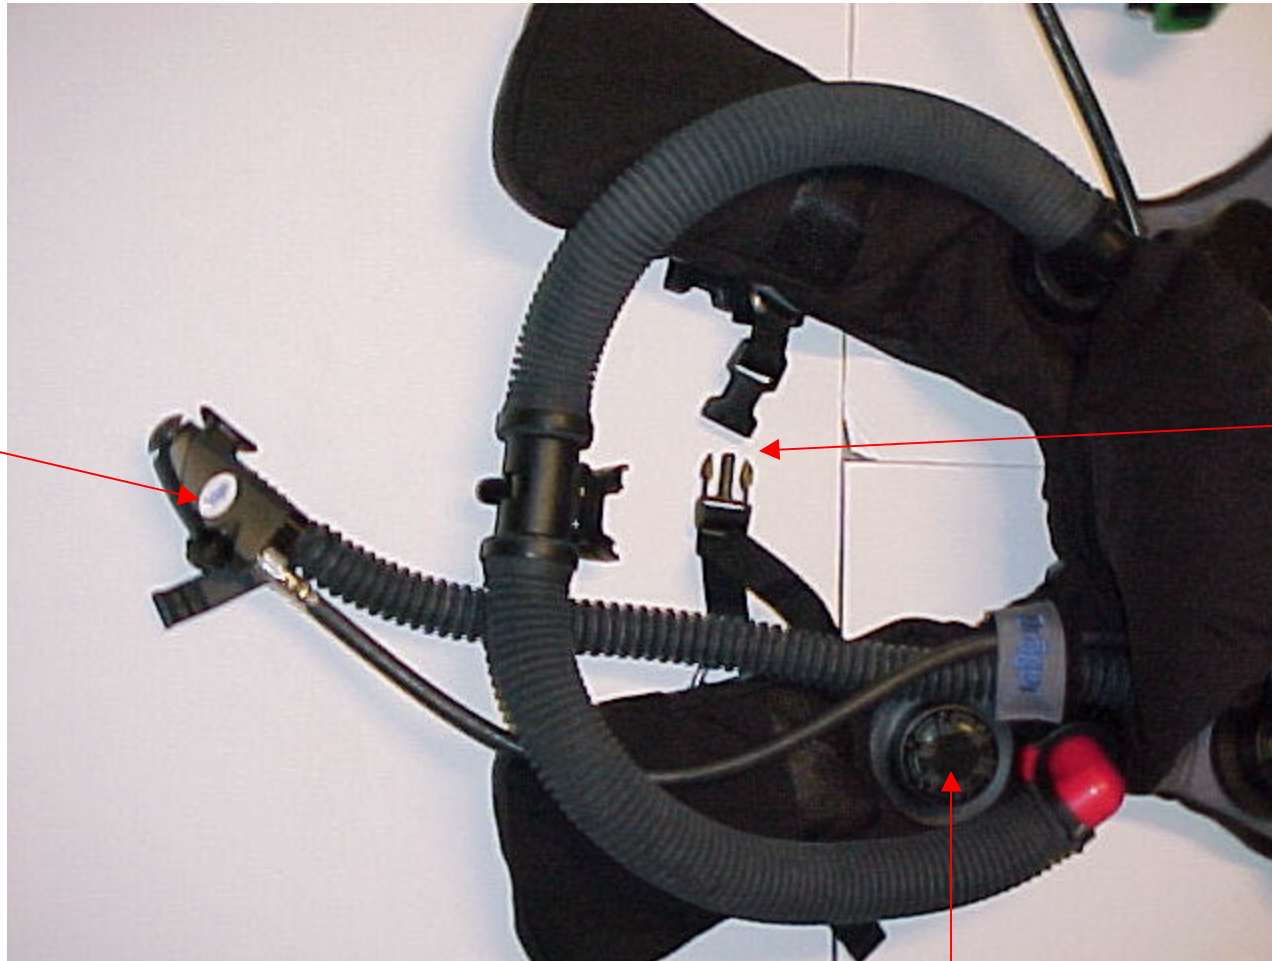

Inflation Unit

**Chest Strap for
keeping Breathing
bags together**

Relief valve adjustable for vertical position in the water



DrägerRay

Dräger



Connection Oxygauge under the strap when not in this position the cylinder can be pressing on this connection




DrägerRay

Dräger



**Right connection of the canister. Note the red O-ring
Must be on the left connection.**


**Spi-wrap Material visible this is making sure a gas flow direct to the system
when the Breating bags are fully collapse by for example a to quick ascent.**

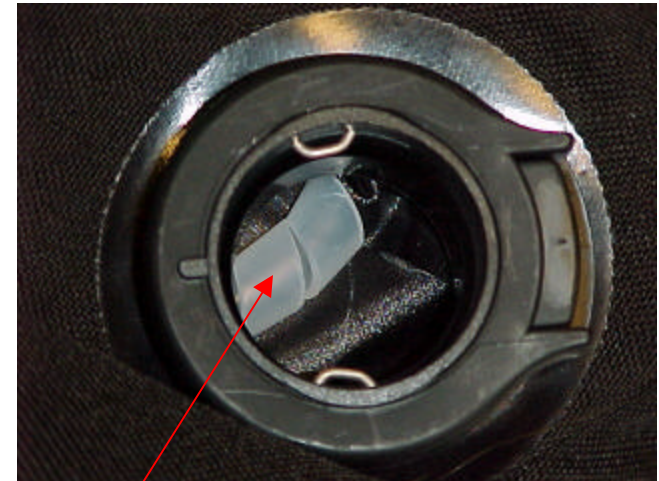



DrägerRay

Dräger

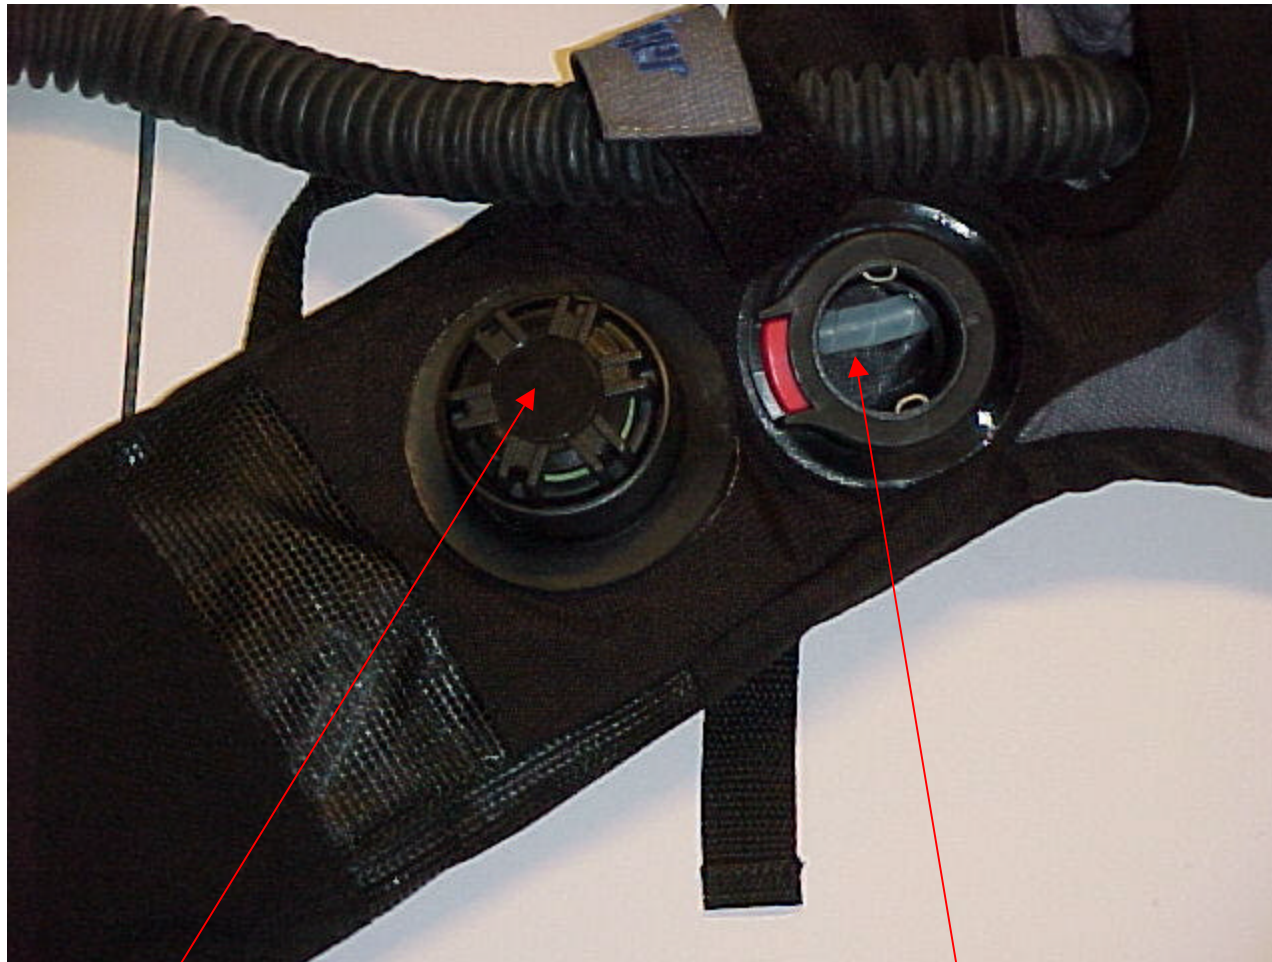

**Relief valve
adjustable between 18 & 25 Mbar**

Push-in connection Exhalation hose



DrägerRay

Dräger



Belly straps Big and Small

Big one is keeping the unit to your body.

Small one preventing buoyancy jacket bending to the out side specially for small persons

Hooks on the bottom side for connection equipment and for cleaning and drying the breathing bags

The water can drip out of the bags when the drain plugs has been removed.



DrägerRay

Dräger



Two deep Pockets with Velcron sealing.




DrägerRay

Dräger



Note the 45degree angle of the push-in connection. The mouthpiece is pointing to the out side . When yuo connect the hoses in this position there will be a pre-setting and gives you the less Force on the mouth-piece s


Mouth-piece Note the space in the barrel, this is to blow the water out before opening the valve. Make sure after servicing that this is in the right position.

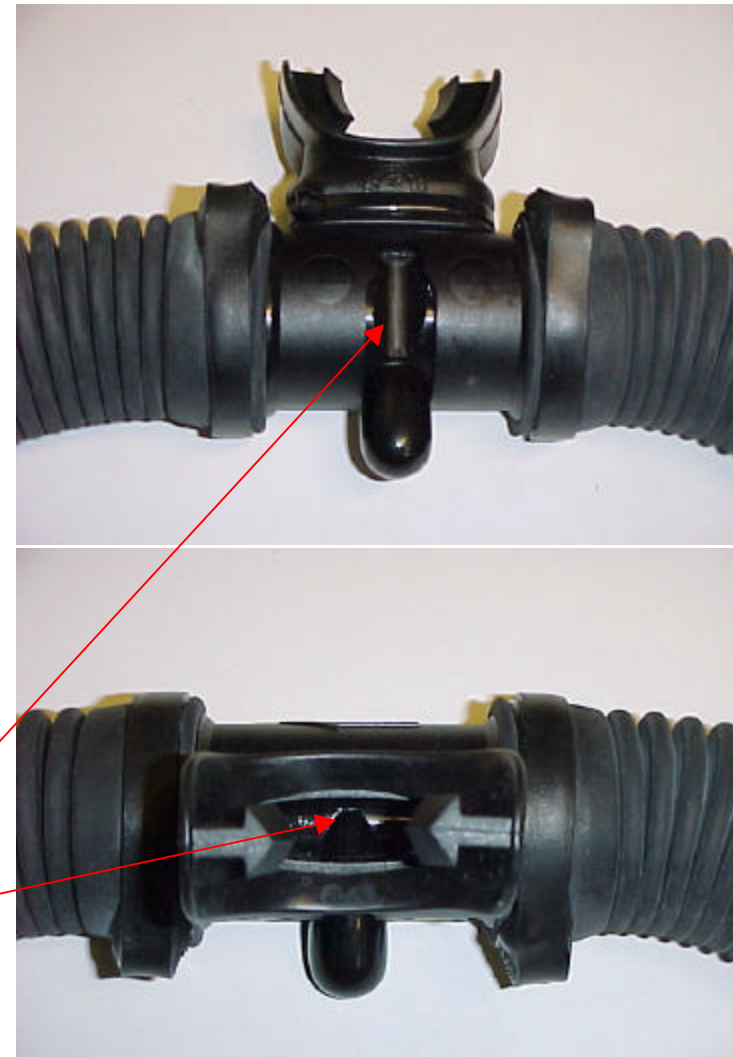



DrägerRay

Dräger

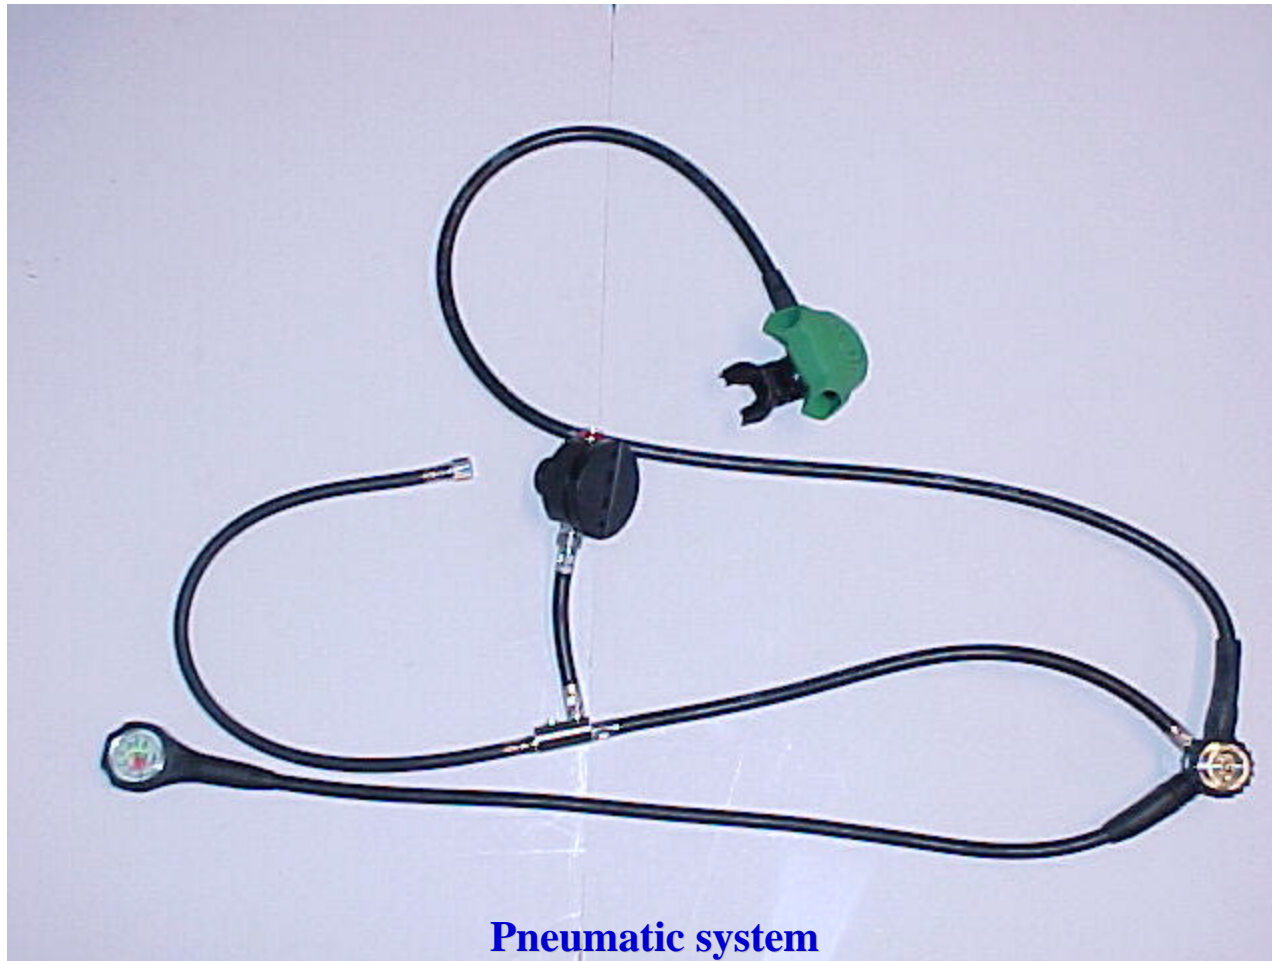

Pneumatic system



DrägerRay

Dräger



Breathing bags with drain plugs and connection of the push-in






DrägerRay

Dräger

**Intermediate pressure
Connection**

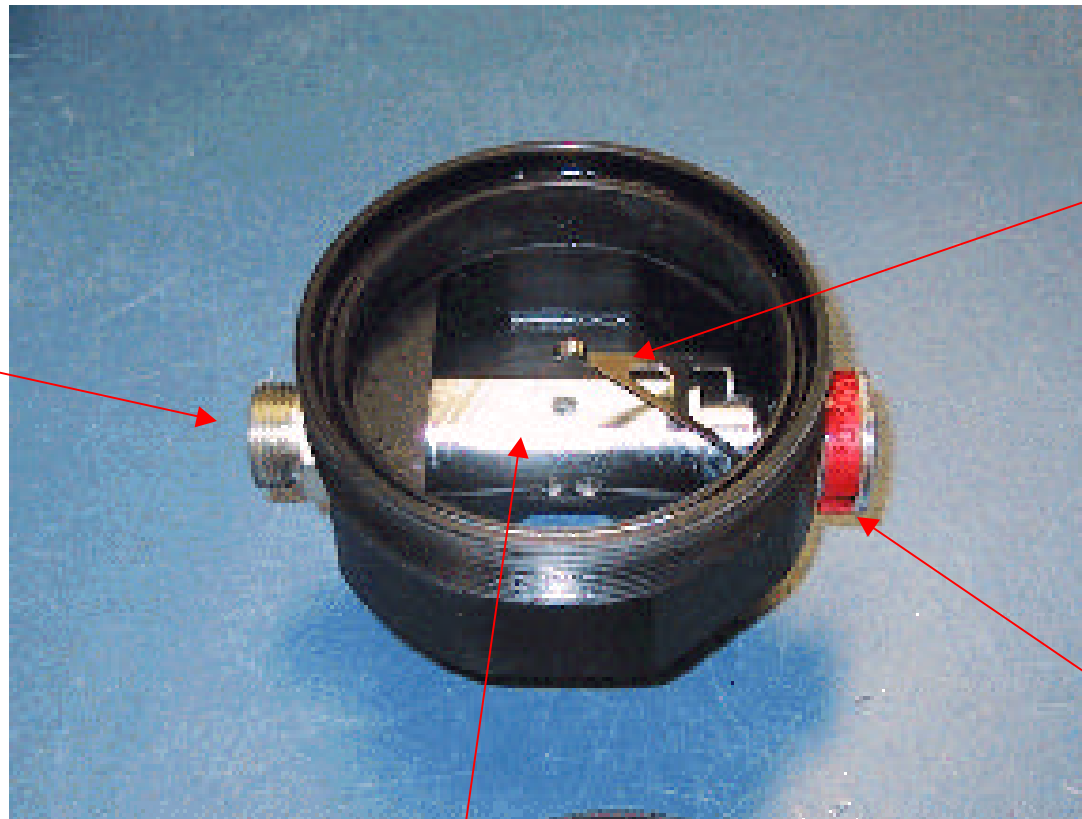

Lever


**Colar ring for
Indication 50%
or 32%**

**By-pass with intergrated Dossage unit
For 32% change complet unit**



DrägerRay

Dräger

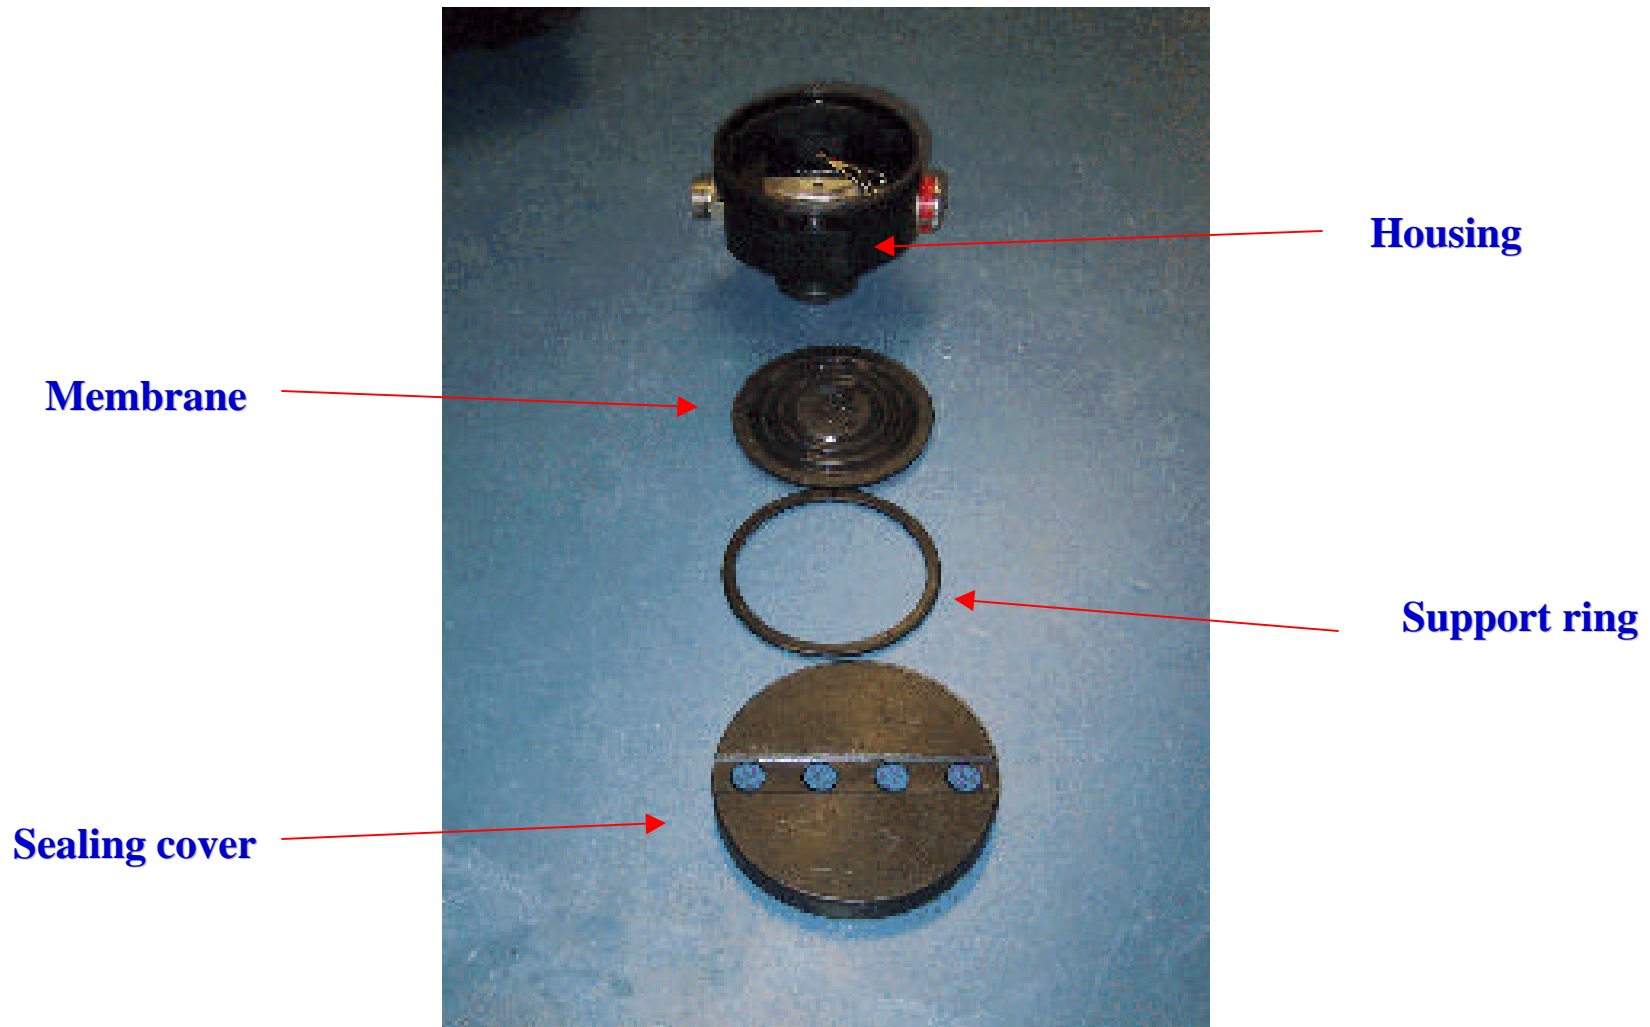



DrägerRay

Dräger

**Connection
Exhalation side**

**Connection
Inhalation side**




**Sealing plug
connection
Oxy gauge**

Removable Sealing rings



DrägerRay

Dräger

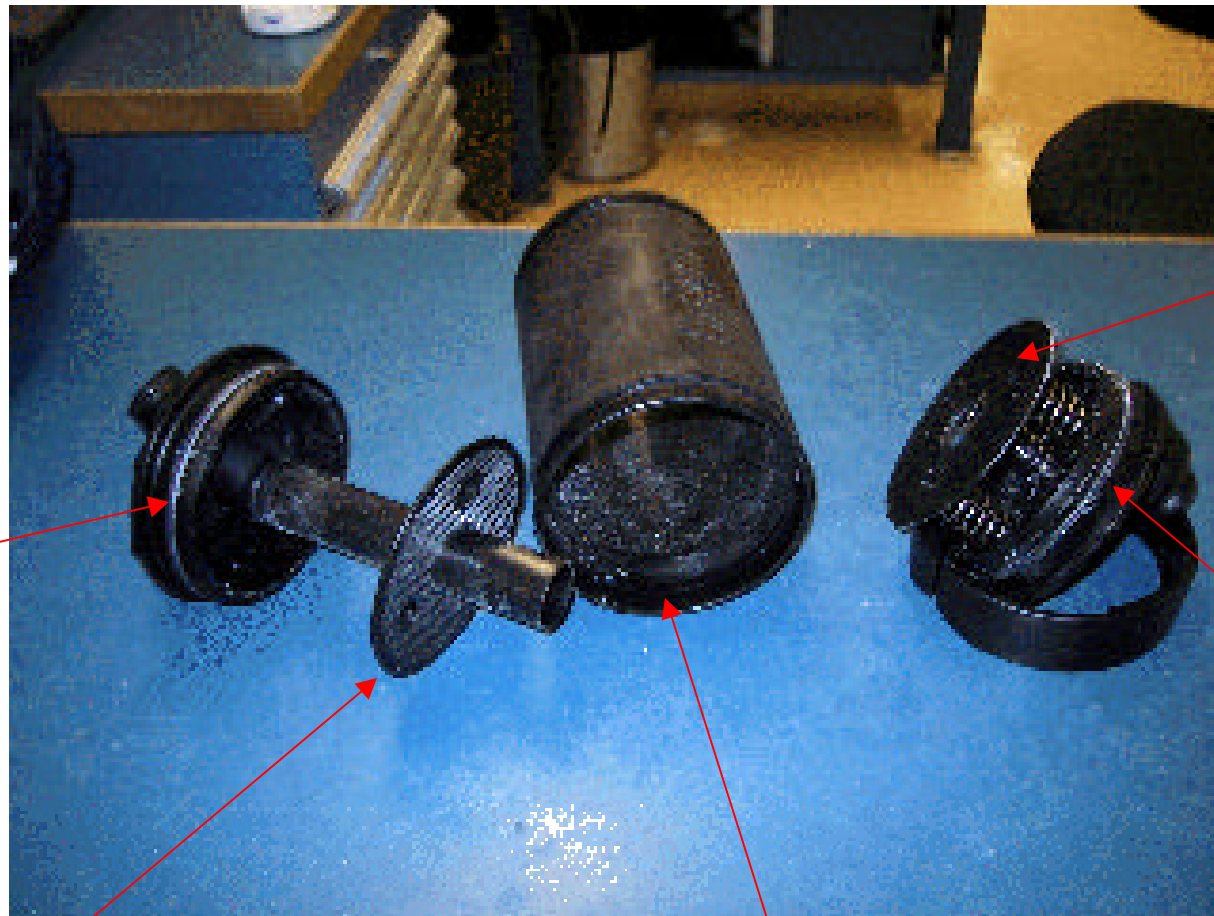

Sieve

O-ring

O-ring sealing

Sieve

Fixing point top Sieve



DrägerRay

Dräger



DrägerRay

Dräger